


THE CONTRACTOR SHALL VERIFY AND FIELD CHECK ALL DIMENSIONS AND CONDUIT RUNS PRIOR TO THE START OF ANY WORK. THE CONTRACTOR SHALL REVIEW ALL DRAWINGS FOR ANY DISCREPANCIES THAT MAY AFFECT HIS OR HER WORK AND REPORT TO THE ARCHITECT AND/OR ENGINEER ANY DISCREPANCIES OR DISCREPANCIES BEFORE REQUESTING A CLARIFICATION PRIOR TO THE START OF ANY WORK. IT IS A WAIVER TO ANY CLAIM BY THE CONTRACTOR FOR ANY ADDITIONAL EXPENSE MADE NECESSARY BY REASON OF LATER INTERPRETATION OF THE DRAWINGS.

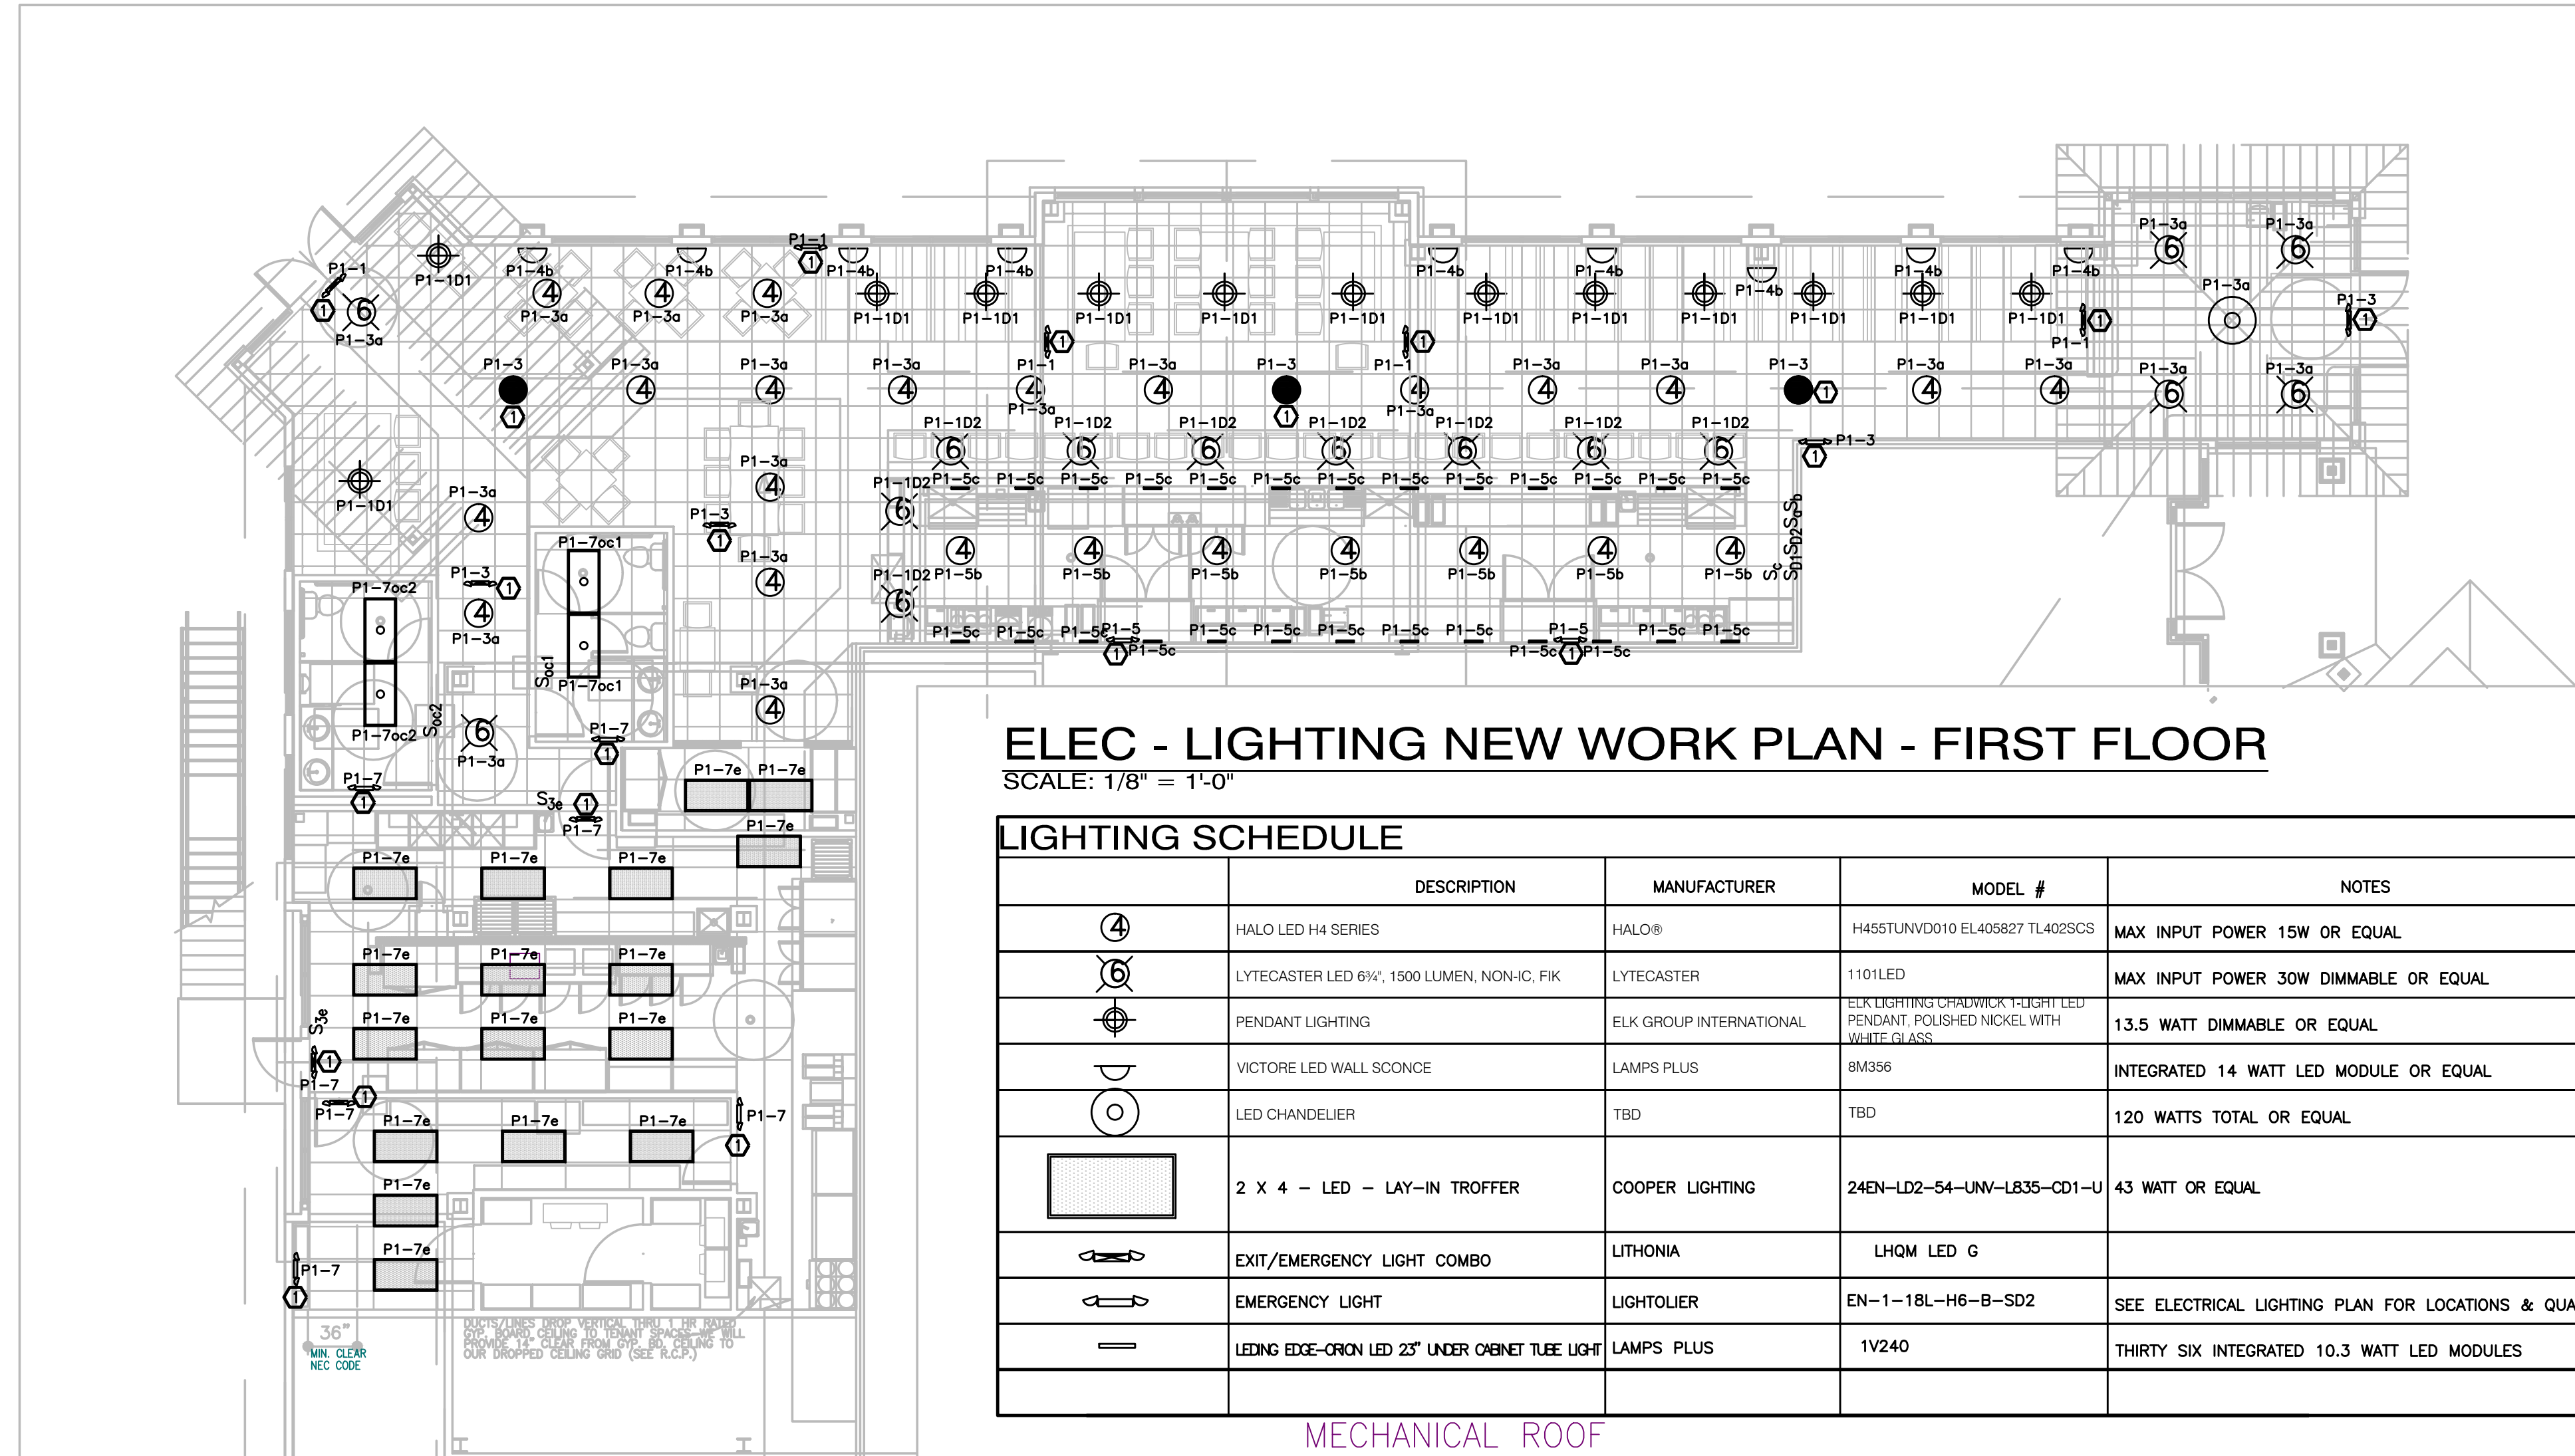

**ELEC - LIGHTING NEW WORK PLAN - FIRST FLOOR**

SCALE: 1/8" = 1'-0"

**LIGHTING SCHEDULE**


SYMBOL	DESCRIPTION	MANUFACTURER	MODEL #	NOTES
④	HALO LED H4 SERIES	HALO®	H455TUNVD010 EL405827 TL402SCS	MAX INPUT POWER 15W OR EQUAL
⑥	LYTECASTER LED 6W, 1500 LUMEN, NON-IC, FIK	LYTECASTER	1101LED	MAX INPUT POWER 30W DIMMABLE OR EQUAL
⊕	PENDANT LIGHTING	ELK GROUP INTERNATIONAL	ELK LIGHTING CRAWFORD 1-LIGHT LED PENDANT, POLISHED NICKEL WITH WHITE GLASS	13.5 WATT DIMMABLE OR EQUAL
⌒	VICTORE LED WALL SCONCE	LAMPS PLUS	6M356	INTEGRATED 14 WATT LED MODULE OR EQUAL
○	LED CHANDELIER	TBD	TBD	120 WATTS TOTAL OR EQUAL
▭	2 X 4 - LED - LAY-IN TROFFER	COOPER LIGHTING	24EN-LD2-54-LNV-LB35-CD1-U	43 WATT OR EQUAL
⚡	EXIT/EMERGENCY LIGHT COMBO	LITHONIA	LHQM LED G	
⚡	EMERGENCY LIGHT	LIGHTOLIER	EN-1-18L-H6-B-SD2	SEE ELECTRICAL LIGHTING PLAN FOR LOCATIONS & QUANTITIES
—	LEDING EDGE-CRON LED 23" UNDER CABINET TUBE LIGHT	LAMPS PLUS	1V240	THIRTY SIX INTEGRATED 10.3 WATT LED MODULES

**LIGHTING - KEYED PLAN NOTES**

- CONNECT EXIT-UNITS AND BATTERY PACKS TO LOCAL CIRCUITS AND AHEAD OF ANY SWITCHING OR OCCUPANCY SENSOR.

**GENERAL PLAN NOTES**


- REFER TO COVER SHEET DRAWING FOR ELECTRICAL LEGENDS & ADDITIONAL INFORMATION
- COORDINATE WITH ARCHITECT/OWNER FOR EXACT MAKE AND MODEL LIGHTING FIXTURE PRIOR ORDERING AND INSTALLATION.
- WHERE DIFFERENCES IN LIGHTING OR QUANTITY OF LIGHT FIXTURES OCCUR BETWEEN ARCHITECT'S DRAWINGS, THE ARCHITECT'S PLAN SHALL DICATE. BRING DISCREPANCIES TO ARCHITECT'S ATTENTION IN WRITING PRIOR TO DEMOLITION/INSTALLATION. CONTRACTOR TO VERIFY LOCATIONS AND QUANTITIES OF ALL EXISTING DEVICES IN FIELD PRIOR TO CONSTRUCTION. GENERAL CONTRACTOR TO VERIFY WITH ARCHITECT FOR LOCATION OF REFLECTED CEILING IN QUESTION PRIOR TO INSTALLATION. REARRANGE RELOCATED LIGHTING TO MATCH WITH NEW REFLECTED CEILING AS REQUIRED.
- ALL SWITCHES & CONTROLS SHALL BE LOCATED TYPICALLY ON THE LATCH SIDE OF DOOR FRAME. U.O.N
- THE LIGHTING POWER DENSITY CALCULATIONS FOR THIS PROJECT MEET IECC.

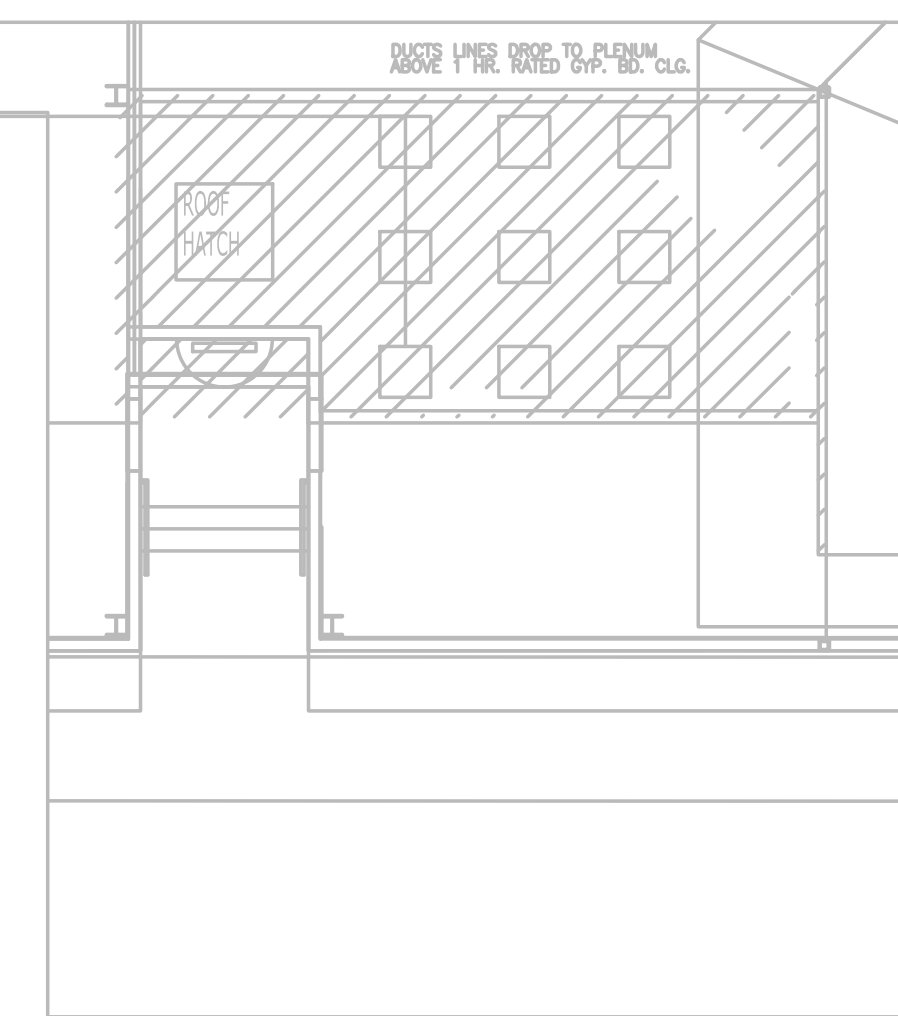

**OCCUPANCY SENSOR SCHEDULE**

TYPE	DESCRIPTION	MFR.	CATALOG NO.	REMARKS
Soc	LEVITON WALL SWITCH SENSOR	LEVITON	OSSMT-MDW	

- GENERAL NOTES:**
- PROVIDE UNIVERSAL VOLTAGE POWER PACK AS NOTED ABOVE.
  - ADJUST TIME-DELAYS TO 10 MINUTES AND SENSITIVITY SETTINGS ON THE BACK OF THE SENSOR AS NECESSARY TO PROVIDE THE DESIRED COVERAGE. MOVE OUT OF THE CONTROLLED AREA - THE LIGHTS SHALL TURN OFF.

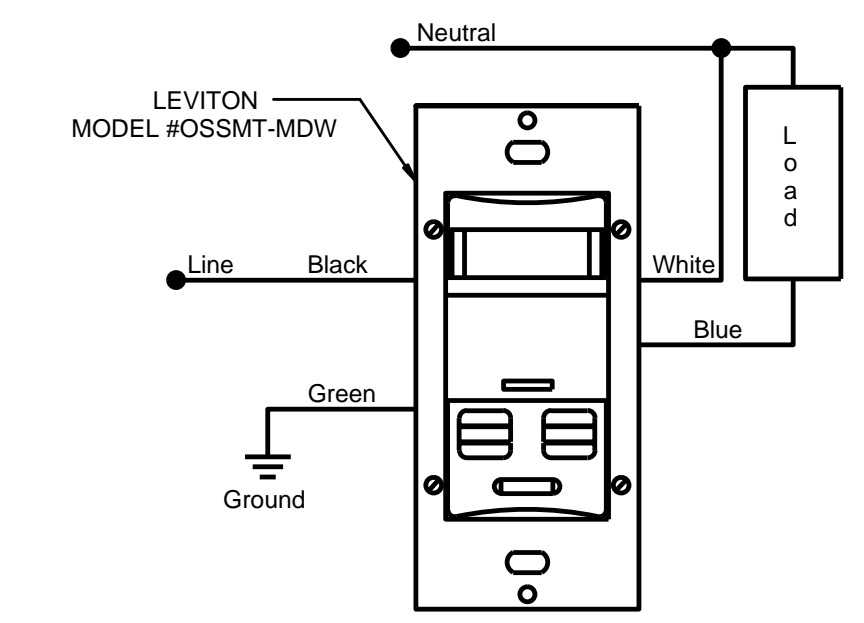

NOTE: RESTROOM SET TO 10 MINUTES. OFFICE SET TO 20 MINUTES.

**# OCCUPANCY SENSOR DETAIL**  
N.T.S.



**REVISION BLOCK**

NO.	DATE	DESCRIPTION

**REVISION BLOCK**

NO.	DATE	DESCRIPTION

MEP ENGINEER  
DIVERSIFIED CONSULTING ENGINEERS, LLC  
PHONE: (301) 641-5823  
MOHAMED BUNDU, P.E., LEED AP  
BUNDU1@VERIZON.NET

CONSULTANT

PROJECT TITLE

DESCRIPTION

SHEET TITLE

ELEC - LIGHTING NEW WORK PLAN

ISSUE BLOCK

DATE	DESCRIPTION
09/29/16	RELEASED FOR MEP WORK
09/27/16	CLIENT REVIEW PRELIMS
09/27/16	CLIENT REVIEW PRELIMS
09/27/16	CLIENT REVIEW PRELIMS
09/27/16	CLIENT REVIEW PRELIMS

PROJECT NO: JERNS-001-16  
DATE: 09/27/16  
SCALE: AS NOTED  
DRAWN BY: MMB | FINAL REVIEW: MMB