


THE CONTRACTOR SHALL VERIFY AND FIELD CHECK ALL DIMENSIONS AND CONDITIONS PRIOR TO THE START OF ANY WORK. THE CONTRACTOR SHALL REVIEW ALL DIMENSIONS AND CONDITIONS THAT MAY AFFECT HIS WORK AND REPORT TO THE ARCHITECT AND/OR ENGINEER ANY CONDITIONS OR DISCREPANCIES BEFORE REQUESTING A CLARIFICATION PRIOR TO THE START OF ANY WORK. IT IS A WAIVER TO ANY CLAIM BY THE CONTRACTOR FOR ADDITIONAL EXPENSE MADE NECESSARY BY REASON OF LATER INTERPRETATION OF THE DRAWINGS.

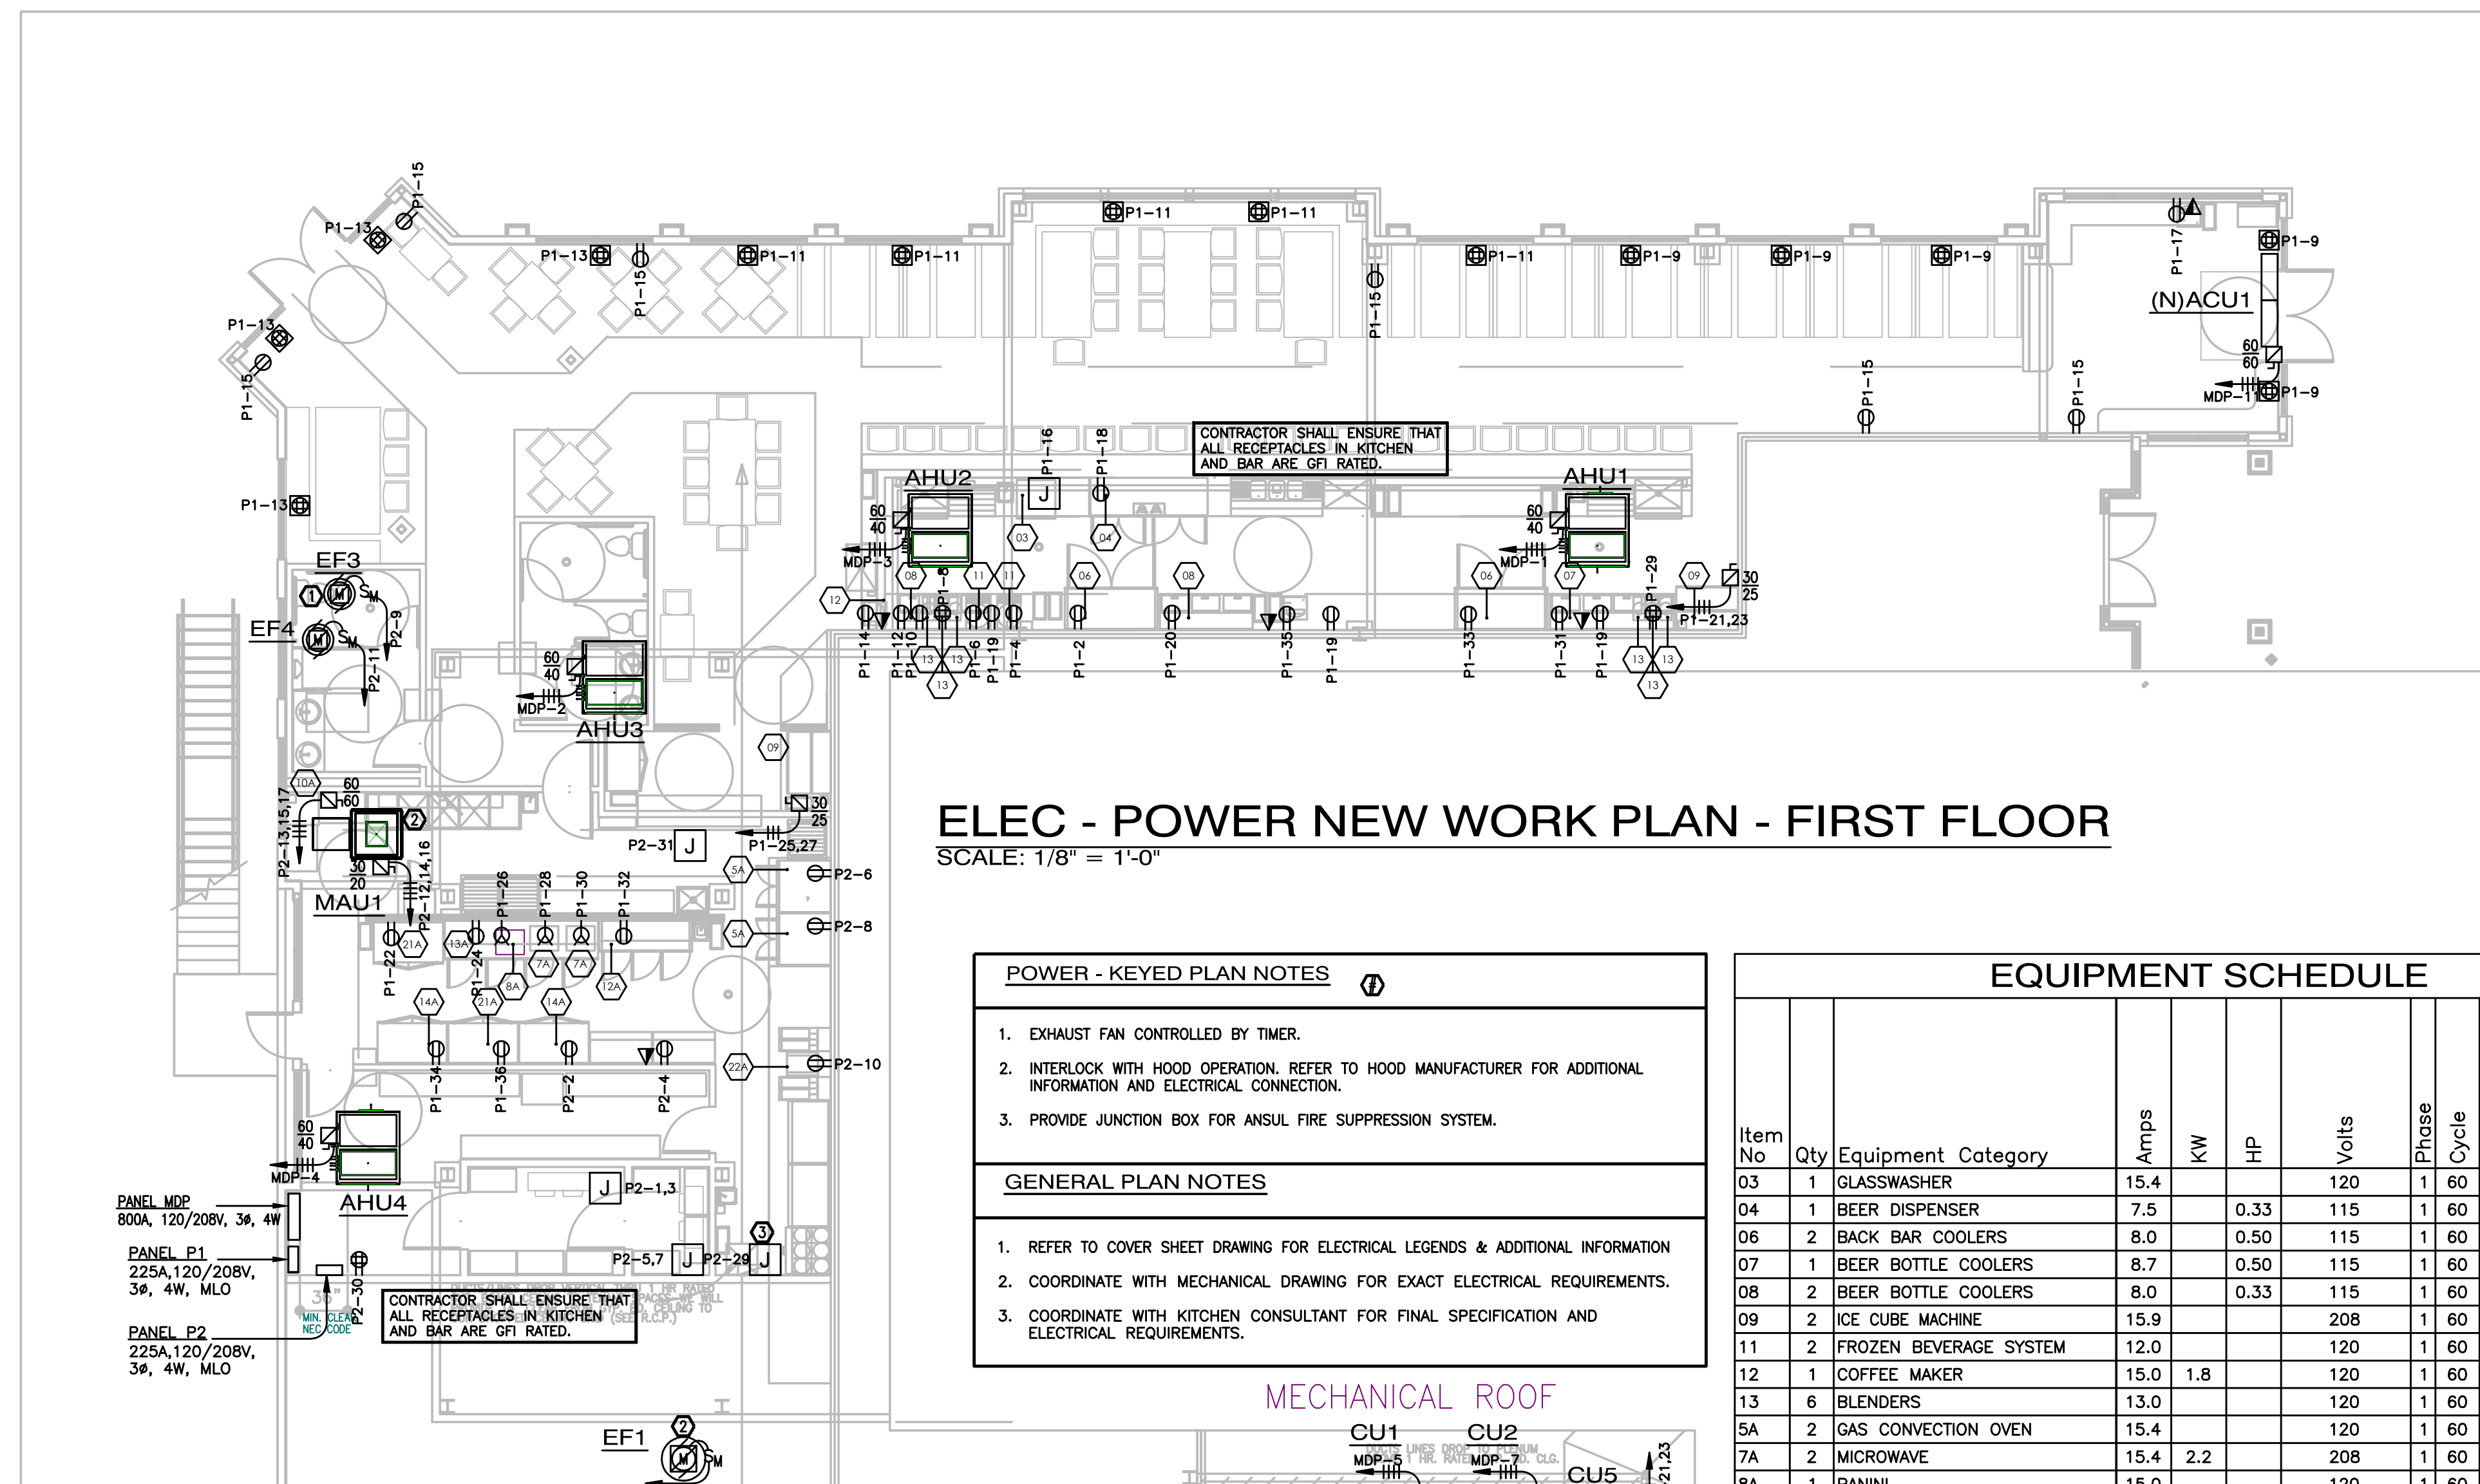

### ELEC - POWER NEW WORK PLAN - FIRST FLOOR

SCALE: 1/8" = 1'-0"

#### POWER - KEYED PLAN NOTES

- EXHAUST FAN CONTROLLED BY TIMER.
- INTERLOCK WITH HOOD OPERATION. REFER TO HOOD MANUFACTURER FOR ADDITIONAL INFORMATION AND ELECTRICAL CONNECTION.
- PROVIDE JUNCTION BOX FOR ANSUL FIRE SUPPRESSION SYSTEM.



#### GENERAL PLAN NOTES

- REFER TO COVER SHEET DRAWING FOR ELECTRICAL LEGENDS & ADDITIONAL INFORMATION.
- COORDINATE WITH MECHANICAL DRAWING FOR EXACT ELECTRICAL REQUIREMENTS.
- COORDINATE WITH KITCHEN CONSULTANT FOR FINAL SPECIFICATION AND ELECTRICAL REQUIREMENTS.

#### EQUIPMENT SCHEDULE

Item No	Qty	Equipment Category	Amps	KW	HP	Volts	Phase	Cycle	Direct	Plug	NEMA
03	1	GLASSWASHER	15.4			120	1	60	X		J-BOX
04	1	BEER DISPENSER	7.5	0.33		115	1	60	X		5-15P
06	2	BACK BAR COOLERS	8.0	0.50		115	1	60	X		5-15P
07	1	BEER BOTTLE COOLERS	8.7	0.50		115	1	60	X		5-15P
08	2	BEER BOTTLE COOLERS	8.0	0.33		115	1	60	X		5-15P
09	2	ICE CUBE MACHINE	15.9			208	1	60	X		J-BOX
11	2	FROZEN BEVERAGE SYSTEM	12.0			120	1	60	X		5-15P
12	1	COFFEE MAKER	15.0	1.8		120	1	60	X		5-15P
13	6	BLENDERS	13.0			120	1	60	X		5-15P
5A	2	GAS CONVECTION OVEN	15.4			120	1	60	X		5-15P
7A	2	MICROWAVE	15.4	2.2		208	1	60	X		6-20
8A	1	PANINI	15.0			120	1	60	X		5-20
10A	1	WAREWASHING	46.3			208	3	60	X		
12A	1	PIZZA PREP TABLE	8.6	0.33		115	1		X		5-15P
13A	1	SANDWICH SALAD	10.3	0.50		115	1		X		5-15P
14A	2	REF UNIT	5.8	0.33		115	1		X		5-15P
21A	2	FREEZER	9.9	0.75		120	1	60	X		5-15P
22A	1	FRY DUMP	9.4	1.1		120	1	60	X		5-15P

#### MECHANICAL ROOF

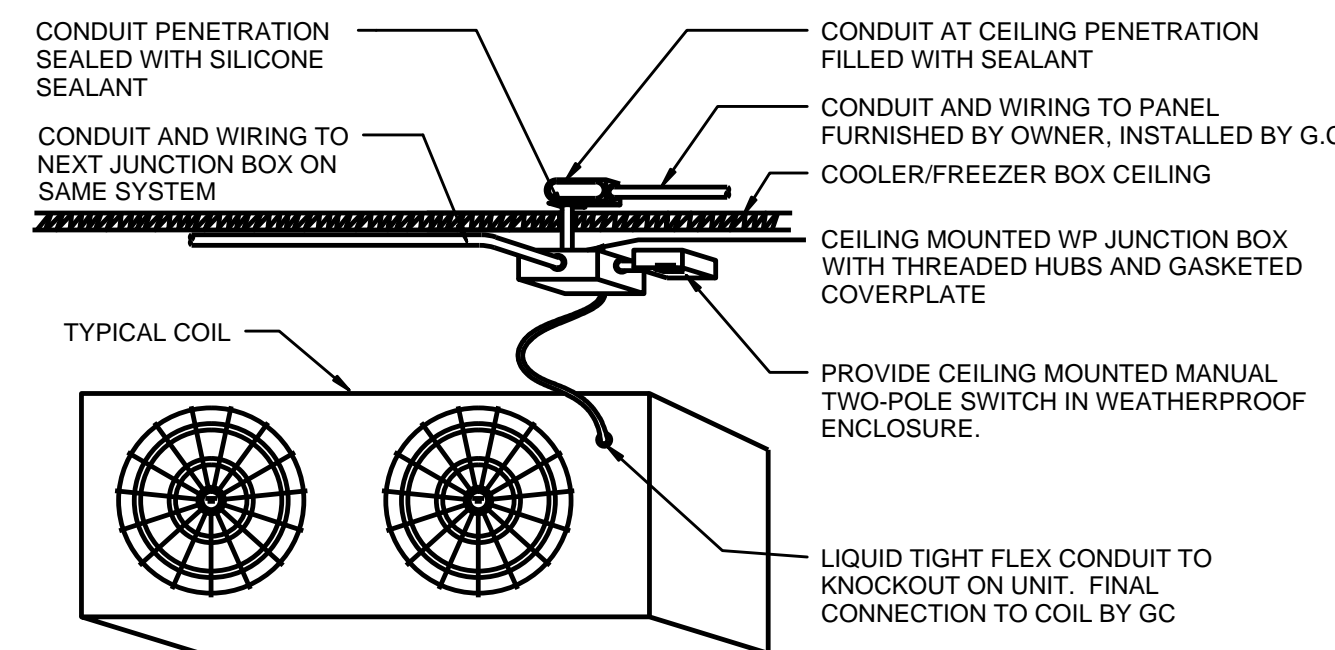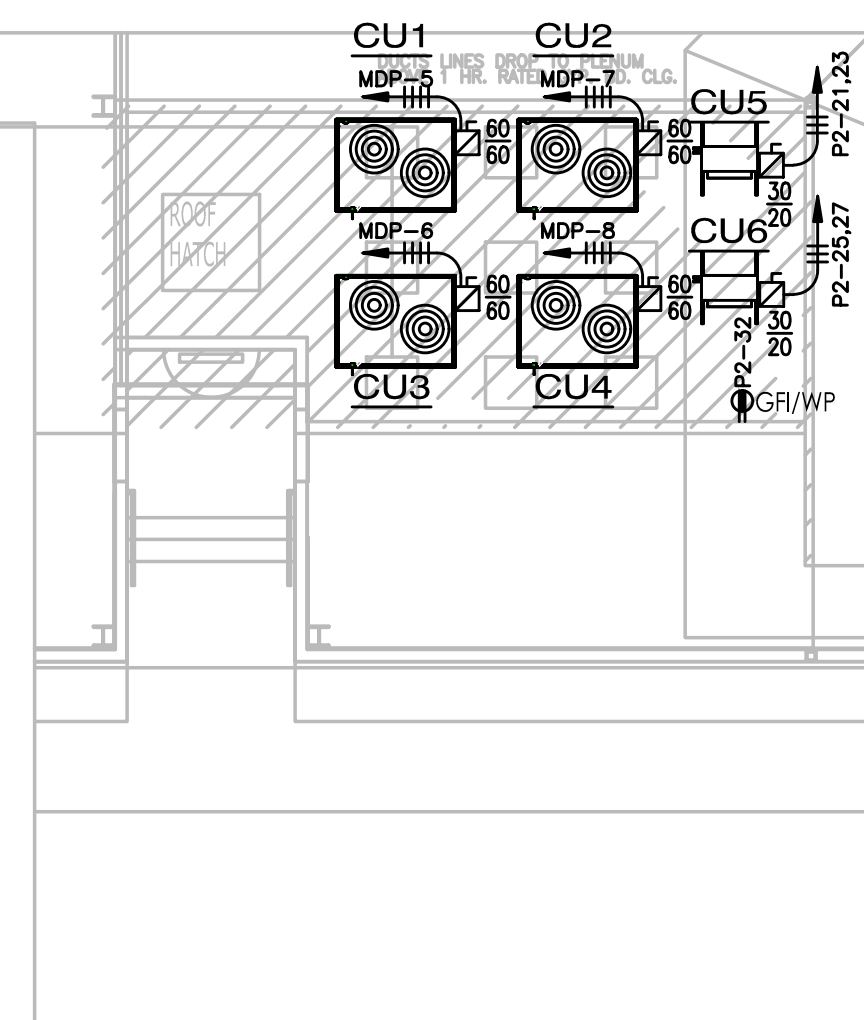

NOTE: DO NOT LOCATE WP JUNCTION BOX DIRECTLY IN FRONT OF DISCHARGE FAN, OFFSET TO SIDE.

REVISION BLOCK	

00/00/00 REVISION DESCRIPTION  
MARK DATE DESCRIPTION


MEP ENGINEER  
DIVERSIFIED CONSULTING ENGINEERS, LLC  
PHONE: (301) 641-5823  
MOHAMED BUNDU, P.E., LEED AP

BUNDU@VERIZON.NET

CONSULTANT

PROJECT TITLE

DESCRIPTION

SHEET TITLE

ELEC - POWER NEW WORK PLAN

ISSUE BLOCK


09/29/16 RELEASED FOR MEP WORK

09/27/16 CLIENT REVIEW PRELIMS

MARK DATE DESCRIPTION

PROJECT NO: JERNS-001-16

DATE: 09/27/16

SCALE: AS NOTED

DRAWN BY: MMB FINAL REVIEW: MMB

